
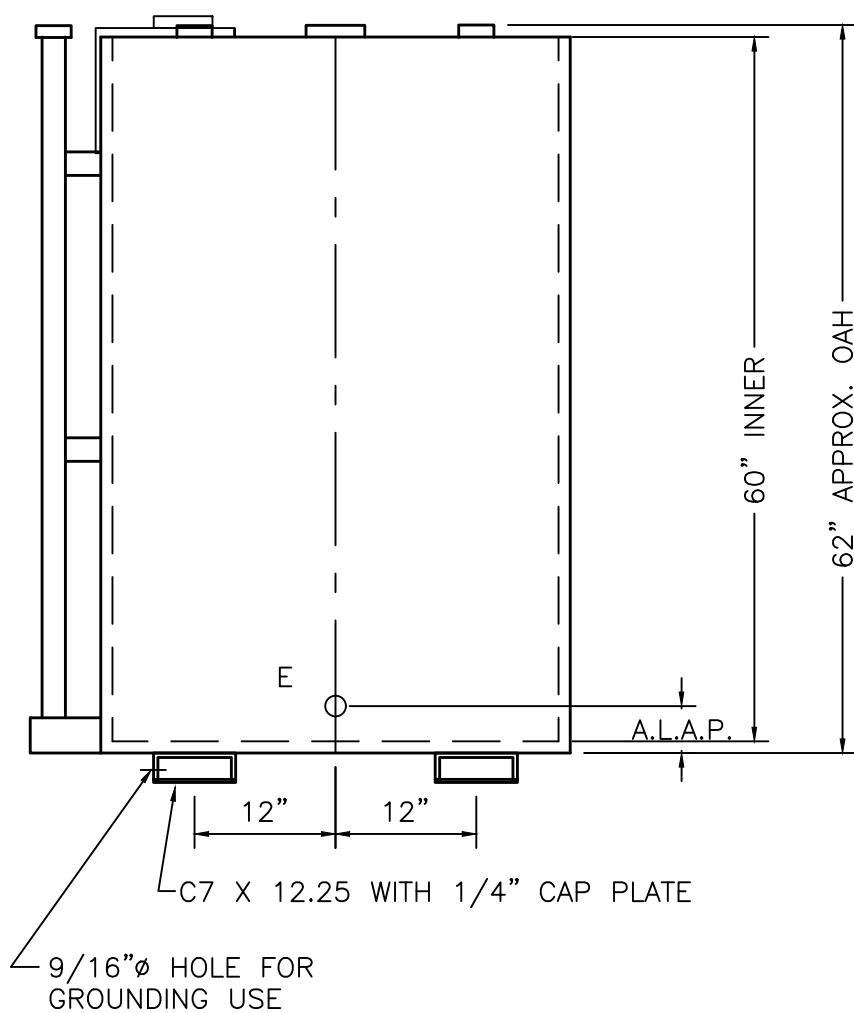


TOUCH UP OF FINISHED PAINT IS
REQUIRED BY INSTALLATION
CONTRACTOR. TOUCH UP PAINT SHIPPED
WITH TANK.

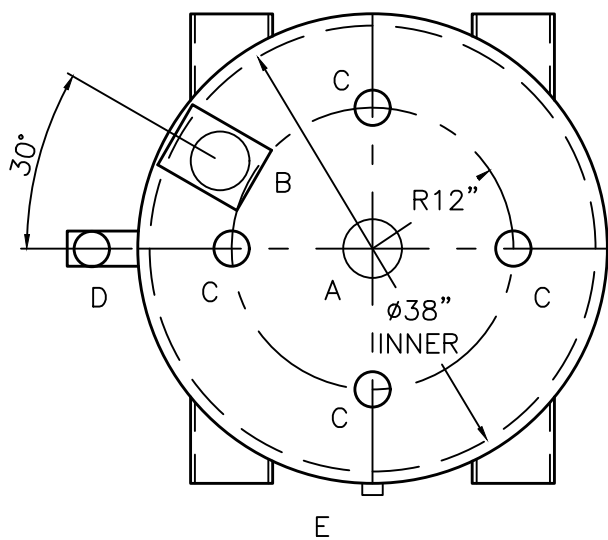

CAPACITY – 300 GALLONS
TYPE – BDV2 DOUBLE WALL
NO. REQ. – –
OPERATING PRESSURE – ATMOSPHERIC
SPECIFIC GRAVITY = 1.0
TANK MATERIAL – MILD CARBON STEEL
THICKNESS – TOP– SINGLE WALL 10 GA FLAT FLANGED
THICKNESS – INNER– SHELL: 12 GA BOTTOM: 12 GA
THICKNESS – OUTER– SHELL: 12 GA BOTTOM: 10 GA
CONSTRUCTION – LAP WELD INNER & OUTER
TOP & BOTTOM HEADS ARE FLAT FLANGED
TANK TEST – INNER: 2 PSIG
OUTER: +2 PSIG OR 13”hg VACUUM
INT. FINISH – NONE
–
EXT. FINISH – SHOP PRIMER
–
LABEL – UL 142

A	4" HALF COUPLING (PRIMARY EMERGENCY VENT USE)
B	4"Ø HALF COUPLING IN INTERSTICE EXTENSION BOX . MARK WITH WANRING LABEL – SECONDARY EMERGENCY VENT USE ONLY
C	2" FNPT FITTING
D	2" INTERSTITIAL MONITOR PIPE
E	3/4" FNPT FITTING
F	—

1. SEE PLAN VIEW FOR TRUE ORIENTATION AND LOCATION OF FITTING
2. LIFTING LUGS FOR UNLOADING UNIT & STANDING UNIT UPRIGHT TO BE PLACED AS NEEDED BY FABRICATION SHOP

