
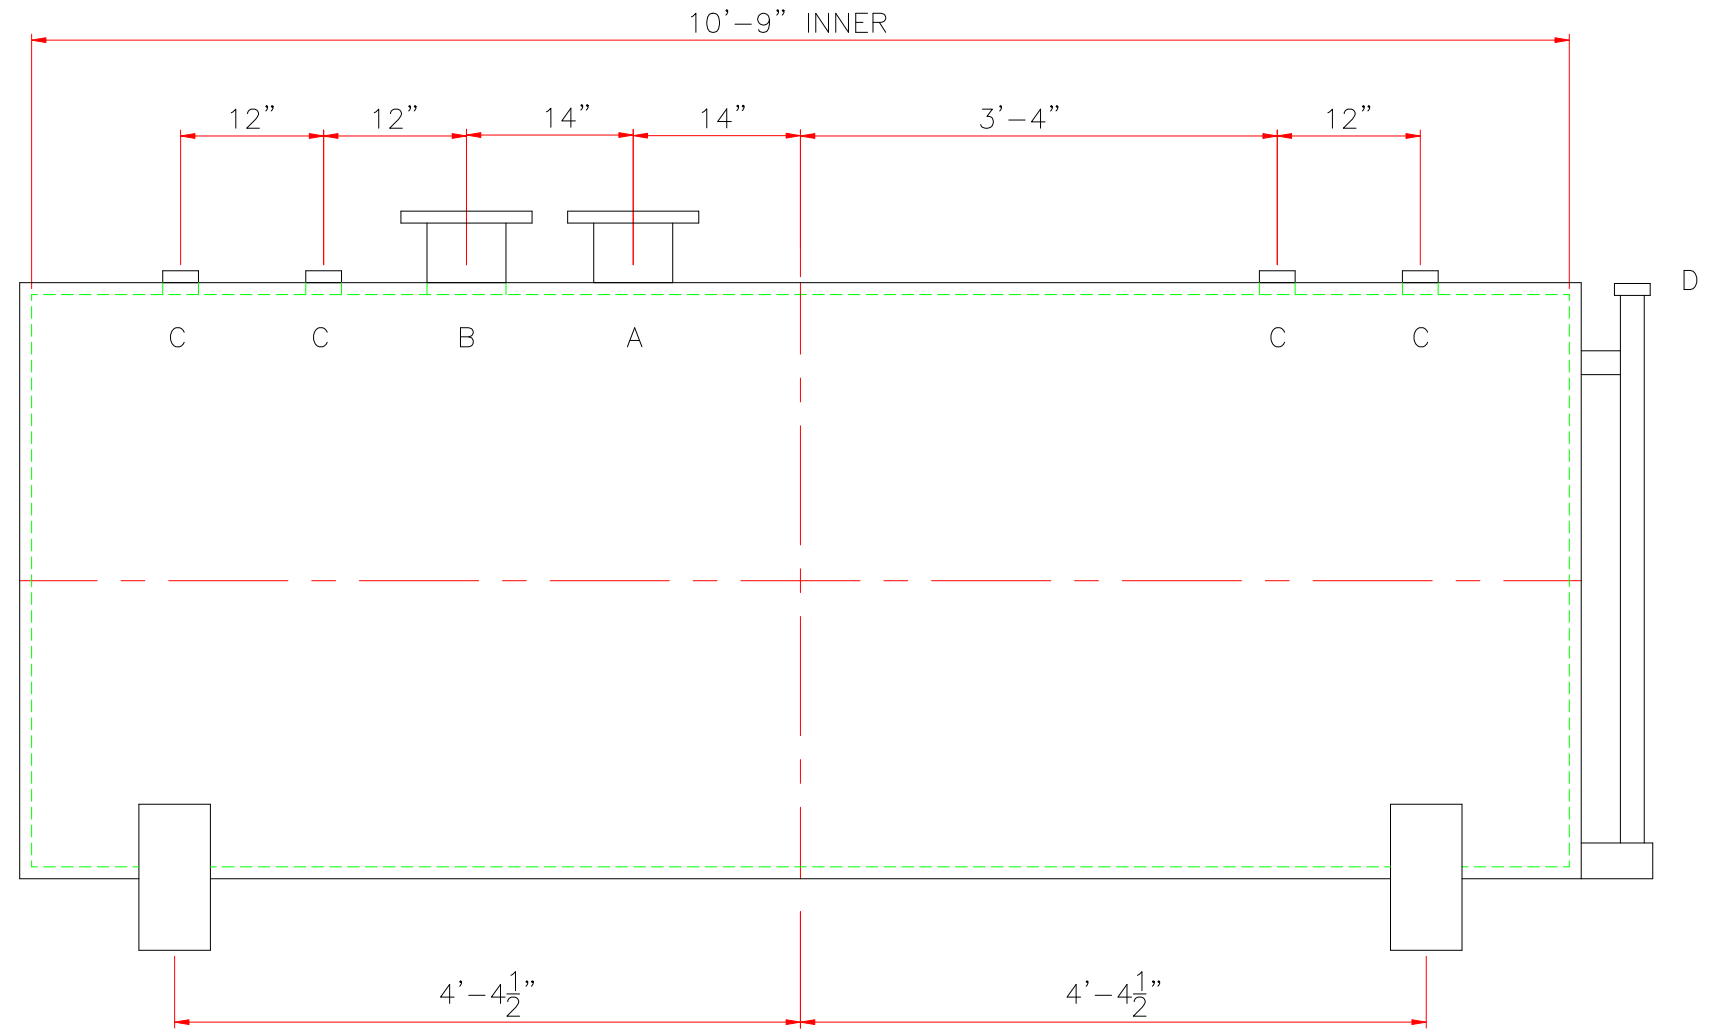


TOUCH UP OF FINISHED PAINT IS
REQUIRED BY INSTALLATION
CONTRACTOR. TOUCH UP PAINT SHIPPED
WITH TANK.

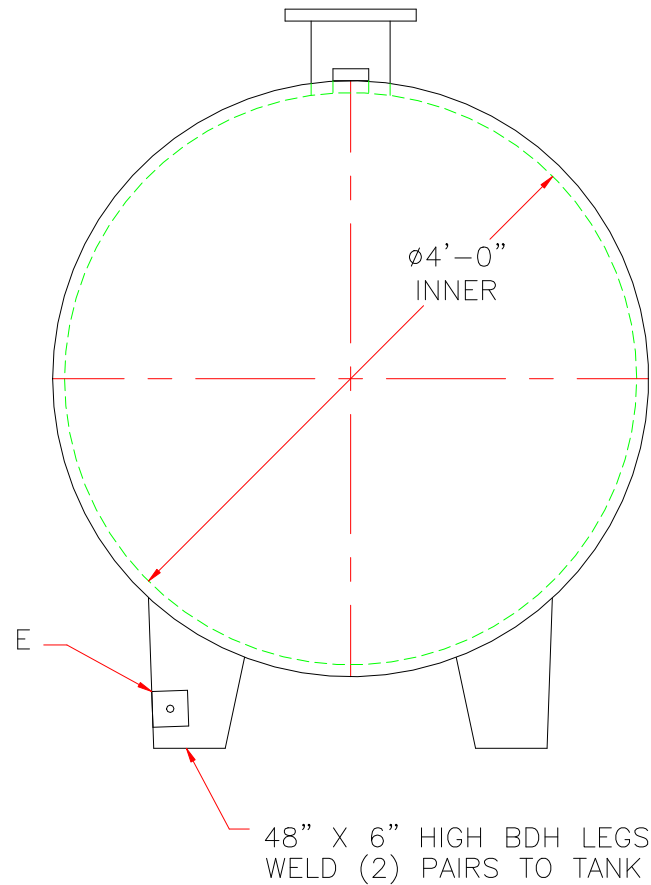

<u>DESIGN DATA</u>	
CAPACITY – 1,000 GALLONS	
TYPE – DOUBLE WALL – TYPE I	
NO. REQ. – –	
OPERATING PRESSURE – ATMOSPHERIC	
SPECIFIC GRAVITY = 1.0	
TANK MATERIAL – MILD CARBON STEEL	
THICKNESS – INNER– HEADS: 10 GA SHELL: 10 GA	
THICKNESS – OUTER– HEADS: 10 GA SHELL: 10 GA	
CONSTRUCTION – INNER – LAP WELD OUTSIDE ONLY OUTER – LAP WELD OUTSIDE ONLY	
TANK TEST – INNER – 5 PSIG OUTER – +3 PSIG OR 13”hg VACUUM	
INT. FINISH – NONE	
EXT. FINISH – SHOP PRIMER	
LABEL – UL 142	

LEGEND	
A	6" FFSO 150# FLANGE THROUGH OUTER SHELL ONLY, MARK WITH SPECIAL WARNING LABEL INTERSTITIAL EMERGENCY VENT USE ONLY
B	6" FFSO 150# FLANGE – PRIMARY EMERGENCY VENT USE
C	2" FITTING
D	2" INTERSTITIAL MONITOR PIPE
E	3" x 3" PLATE w/ 1/2"Ø (MIN.) HOLE ON CENTER (GROUNDING LUG—ONE REQ'D)
F	—

		<h1>Highland Tank</h1>	
<p>UNLESS NOTED, TOLERANCES ARE +/- 1"</p>			
<p>1,000 GAL 48"Ø DW BDH TANK</p>			
<p>CUSTOMER:</p>			
<p>PROJECT:</p>			
<p>QUOTE NO:</p>			<p>CHK'D BY:</p>
<p>SCALE: 3/4" = 12"</p>	<p>DATE:</p>	<p>DWG. BY:</p>	<p>DWG. NO: 01000BDH48DW10GA</p>