
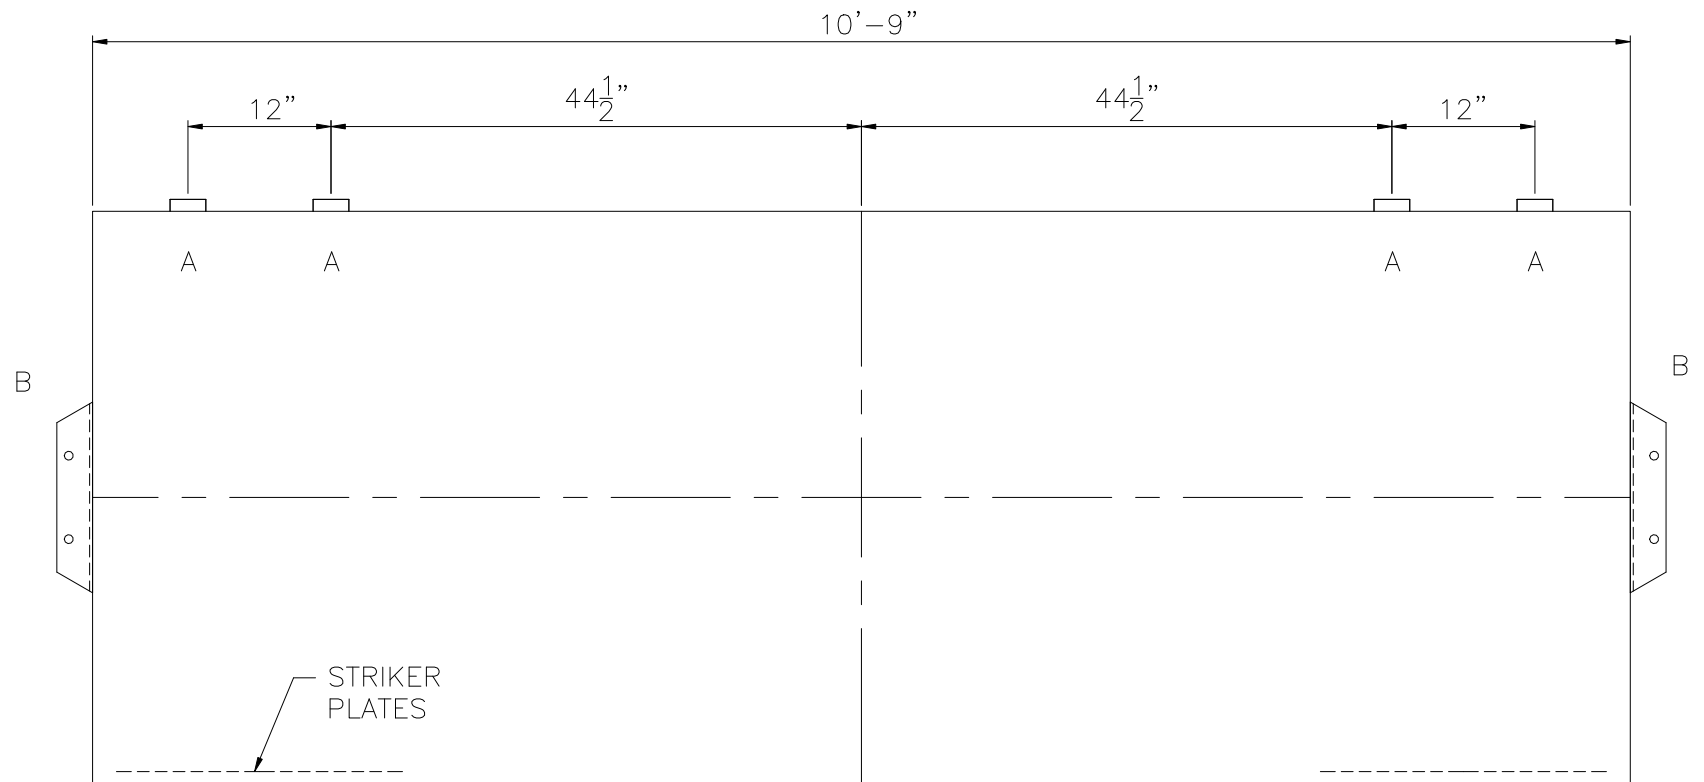


NOTE: ALL RIGHTS RESERVED. THIS DRAWING MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK®. HIGHLAND TANK® SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE AND LOCATION OF FITTINGS, ACCESSORIES, AND COATINGS SHOWN ON THIS DRAWING.

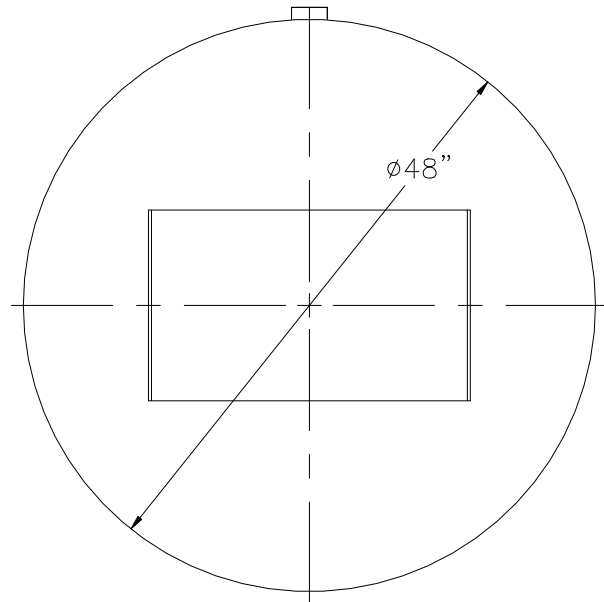

<u>DESIGN DATA</u>
CAPACITY – 1,000 GALLONS
TYPE – SINGLE WALL, HIGHGUARD UNDERGROUND
NO. REQ. – –
OPERATING PRESSURE – ATMOSPHERIC
TANK MATERIAL – MILD CARBON STEEL
THICKNESS – HEADS– 10 GA
THICKNESS – SHELL– 10 GA
*GA THK. BASED ON 60” MAX. BURIAL DEPTH
CONSTRUCTION – FLAT FLANGED HEADS, LAP WELD ALL EXTERIOR SEAMS ONLY
TANK TEST – 5 PSIG
INT. FINISH – NONE –
EXT. FINISH – SP6 BLAST, 75 MILS POLYURETHANE –
LABEL – UL-1746 PART IV, HIGHGUARD (UL58)

<u>LEGEND</u>	
A	2" FITTING
B	HTM SPIN BRK'T – MFG USE ONLY – NOT TO BE USED FOR FIELD INSTALLATION
C	–
D	–
E	–
F	–

NOTES:

- 1) THE HIGHGUARD TANK IS NOT APPROVED FOR THE STORAGE OF HEATED PRODUCTS.
- 2) 15,000 VOLT SPARK TEST PROVIDED AT FACTORY.
- 3) SHOP TO INSTALL 1/4"x12"x12" STRIKER PLATES, ROLLED AND SEAL WELD TO THE TANK.

 <h1 data-bbox="2610 1477 2999 1564">Highland Tank</h1>	
UNLESS NOTED, TOLERANCES ARE $\pm 1"$	
1,000 GAL 48"Ø SW HIGHGUARD	
CUSTOMER:	
PROJECT:	
QUOTE NO:	CHK'D BY:
SCALE: 3/4"=1'-0"	DATE:
DWG. BY:	DWG. NO:
01000HCSW48GA10	