


NOTE :
ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK.
HIGHLAND TANK SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE / LOCATION OF FITTINGS , ACCESSORIES & COATINGS SHOWN ON THIS DRAWING

NOTE :
SEE PLAN VIEW FOR TRUE ORIENTATION & LOCATION OF FITTINGS


NOTE :
LIFTING LUGS FOR UNLOADING UNIT & STANDING UNIT UPRIGHT TO BE PLACED AS NEEDED BY FABRICATION SHOP

FITTING SCHEDULE

A= 4 Ø NPT
B= 6 Ø NPT (EMERGENCY VENT)

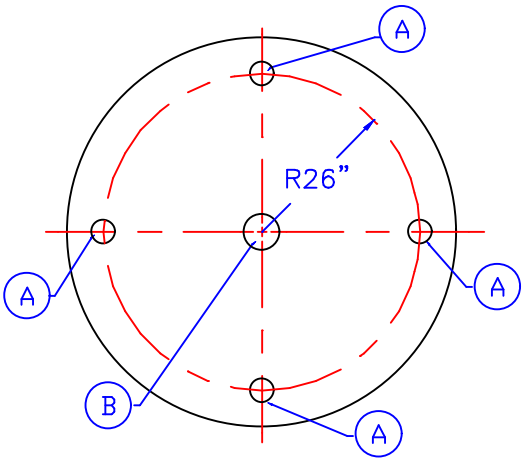

PLAN

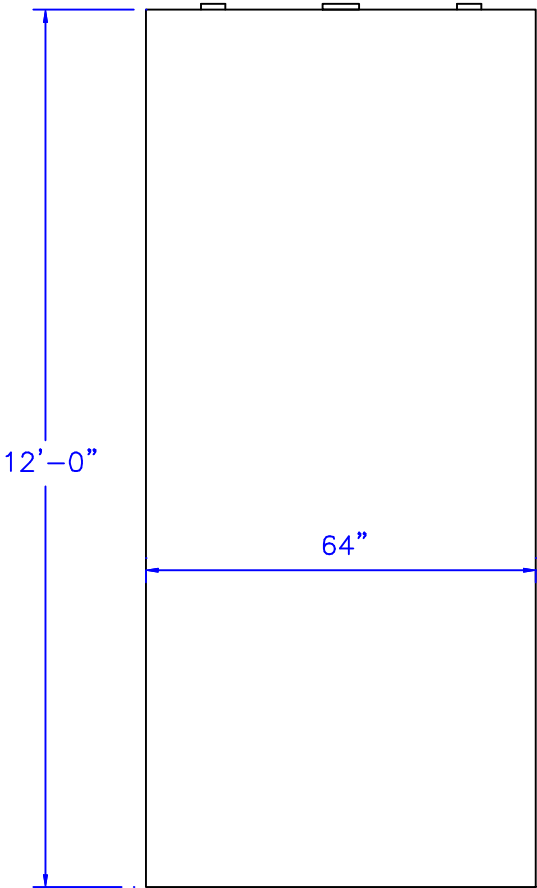

ELEVATION

GENERAL NOTES

CAPACITY : 2000 GALLONS
TYPE : SINGLE WALL, ABOVEGROUND, VERTICAL
NO. REQ. :
MATERIAL : MILD CARBON STEEL
TEST : 1.5 TO 2.5 P.S.I.
MIN. GAUGE OR THICKNESS (PER U.L. 142):
 BOTTOM HEAD : 7 GA.
 SHELL : 7 GA.
 TOP HEAD : 10 GA.

PAINT :
 INTERIOR : NONE
 EXTERIOR : RED PRIMER
CONSTRUCTION : FLAT BOTTOM HEAD, FLAT TOP HEAD.
 LAP WELD ALL EXTERIOR SEAMS EXCEPT
 BUTT WELD ALL LONGITUDINAL SEAMS

APPROVED LABELS : U.L. 142

REVISIONS					
		Highland Tank			
2000 GALLON ABOVEGROUND VERTICAL SINGLE WALL					
CUSTOMER:					
PROJECT:					
QUOTE NO:		CHK'D BY:			
SCALE: 3/8" = 1'-0"	DATE: 5-19-99	DWG. BY:	DWG. NO.: 2K AV SW		