


TOUCH UP OF FINISHED PAINT IS
REQUIRED BY INSTALLATION
CONTRACTOR. TOUCH UP PAINT SHIPPED
WITH TANK.

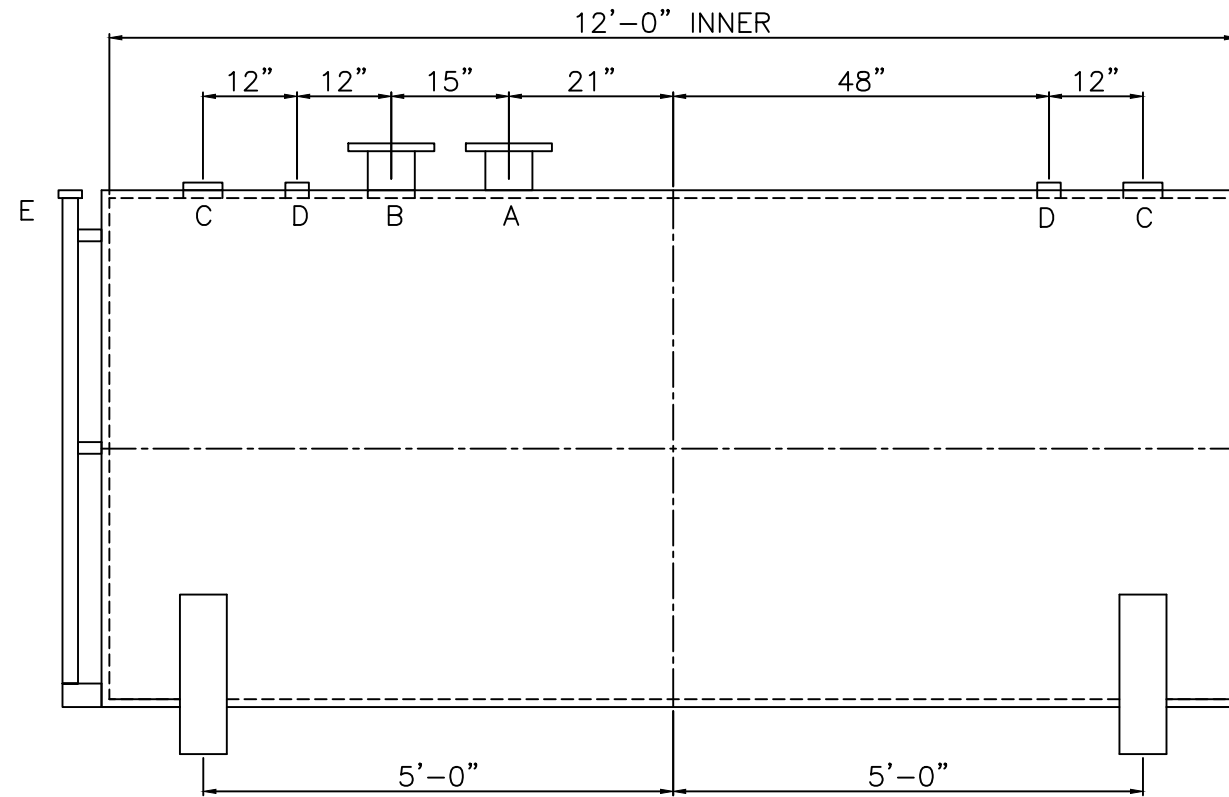

<u>DESIGN DATA</u>	
CAPACITY – 2,000 GALLONS	
TYPE – DOUBLE WALL – TYPE I	
NO. REQ. –	
OPERATING PRESSURE – ATMOSPHERIC	
SPECIFIC GRAVITY = 1.0	
TANK MATERIAL – MILD CARBON STEEL	
THICKNESS – INNER– HEADS: 7 GA SHELL: 7 GA	
THICKNESS – OUTER– HEADS: 10 GA SHELL: 10 GA	
CONSTRUCTION – INNER – LAP WELD OUTSIDE ONLY OUTER – LAP WELD OUTSIDE ONLY	
TANK TEST – INNER – 5 PSIG OUTER – +3 PSIG OR 13”hg VACUUM	
INT. FINISH – NONE	
EXT. FINISH – SHOP PRIMER	
LABEL – UL 142	

<u>LEGEND</u>	
A	6" FFSO 150# FLANGE THROUGH OUTER SHELL ONLY, MARK WITH SPECIAL WARNING LABEL – INTERSTITIAL EMERGENCY VENT USE ONLY
B	6" FFSO 150# FLANGE – PRIMARY EMERGENCY VENT USE ONLY
C	4" FITTING
D	2" FITTING
E	2" INTERSTITIAL MONITOR PIPE
F	3" x 3" PLATE w/ 1/2"ø (MIN.) HOLE ON CENTER (GROUNDING LUG—ONE REQ'D)

 Highland Tank	
UNLESS NOTED, TOLERANCES ARE +/- 1"	
2,000 GAL 64"Ø DW BDH TANK	
CUSTOMER:	
PROJECT:	
QUOTE NO:	CHK'D BY:
SCALE: 1/2" = 12"	DATE:
DWG. BY:	DWG. NO: 02000BDHDW64