GENERAL SPECIFICATIONS

NO. REQ'D: (1) CAPACITY: 2000 GALLON TYPE: HT, HIGHGUARD, DOUBLE WALL MATERIAL: MILD CARBON STEEL

FLOW RATE: 200 GPM

GAUGE: OUTER INNER SHELL-7 GA. 10 GA. HEADS-7 GA. 10 GA.

SURFACE PREP:


SSPC NO.6 BLAST ALL EXTERIOR SURFACES COATING: MATERIAL THICKNESS EXTERIOR-POLYURETHANE (75 MILS)


INTERIOR-NONE


CONSTRUCTION: LAP FIT & WELD ALL EXTERIOR SEAMS

OPERATING PRESSURE: ATMOSPHERIC

- 1. POLYURETHANE HIGHGUARD TANK IS NOT APPROVED FOR THE STORAGE OF HEATED PRODUCTS
- 2. ALL VENT PIPING BY INSTALLER
- 3. 15000 VOLT SPARK TEST PROVIDED AT FACTORY



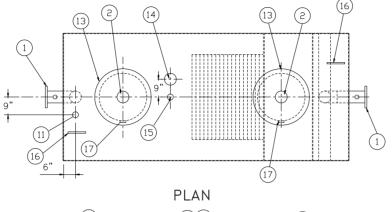

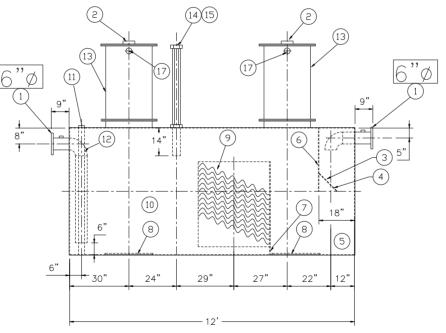

NOTE:

ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK.

HIGHLAND TANK SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE / LOCATION OF FITTINGS , ACCESSORIES & COATINGS SHOWN ON THIS DRAWING

ELEVATION

PROVIDED FOUIPMENT

- 1. 150# R.F.S.O. FLANGE W/ 2" NPT FOR VENT 2. 4"ø FTG. FOR GAUGE WITH PLUG TYP. BOTH MANWAYS
- 3. VELOCITY HEAD DIFFUSION BAFFLE
- 4. WEAR PLATE
- 5. SEDIMENT CHAMBER
- 6. UNDERFLOW BAFFLE
- 7. SLUDGE BAFFLE 8. STRIKER PLATES
- 9. PARALLEL CORRUGATED PLATE COALESCER. CORELLA PVC PLATES
 10. OIL/WATER SEPARATOR CHAMBER
 11. 2"Ø FTG. FOR LEAK DETECTION

- 12. OUTLET DOWNCOMER
- 13. 24" MANWAY WITH BOLT-ON EXTENSION SHIPPED LOOSE
- 14. 4"Ø FTG. FOR OIL PUMPOUT W/ INTERNAL PIPE INSTALLED & RISER PIPE SHIPPED LOOSE
- 15. 2"ø FTG. FOR LEVEL SENSOR W/ RISER PIPE SHIPPED LOOSE
- 16. LIFTING LUG
- 17. 2"ø FTG. FOR VENT TYP. BOTH MANWAYS

