## GENERAL SPECIFICATIONS

NO. REQ'D: (1)
CAPACITY: 2000 GALLONS CAPACITY:

TYPE: HT, HIGHGUARD, DOUBLE WALL, "J" SERIES MATERIAL: MILD CARBON STEEL FLOW RATE: 200 GPM

GAUGE: INNER OUTER SHELL-10 GA. 10 GA. HEADS-

## SURFACE PREP:

SSPC NO.6 BLAST ALL EXTERIOR SURFACES
 SSPC NO.10 BLAST ALL INTERIOR SURFACES
 OF WATER CHAMBER ONLY

COATING: MATERIAL **THICKNESS** EXTERIOR-HIGHGUARD (75 MILS) INTERIOR-POLYURETHANE (15 MILS) INTERIOR OF WATER


CHAMBER ONLY
CONSTRUCTION: LAP FIT AND WELD ALL EXTERIOR SEAMS
OPERATING PRESSURE: ATMOSPHERIC


## NOTES:

1. POLYURETHANE HIGHGUARD TANK IS NOT APPROVED FOR THE STORAGE OF HEATED PRODUCTS
2. CUSTOMER TO PROVIDE PUMPING INFORMATION

FOR PROPER PUMP SIZING & PUMPOUT DESIGN.
3. 15000 VOLT SPARK TEST PROVIDED AT FACTORY

4. ALL VENT PIPING BY INSTALLER

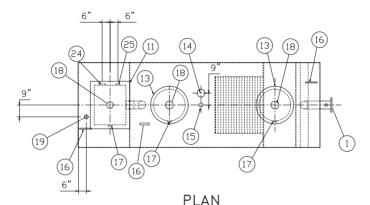




END VIEW

NOTE:
ALL RICHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST
NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK.

HIGHLAND TANK SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED

ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED, CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE / LOCATION OF FITTINGS , ACCESSORIES & COATINGS SHOWN ON THIS DRAWING

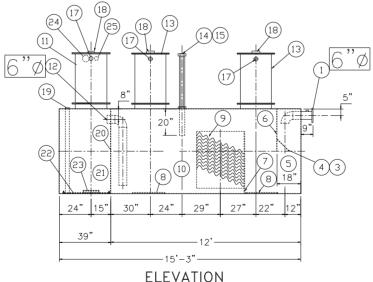

## PROVIDED FQUIPMENT

- 1. 150# R.F.S.O. FLANGE W/ 2" NPT FOR VENT
- 3. VELOCITY HEAD DIFFUSION BAFFLE
- 4. WEAR PLATE
- 5. SEDIMENT CHAMBER
- 6. UNDERFLOW BAFFLE
- 7. SLUDGE BAFFLE
- 8. STRIKER PLATES
- 9. PARALLEL CORRUGATED PLATE COALESCER
- 10. OIL /WATER SEPARATOR CHAMBER
- 11. RECTANGULAR MANWAY W/ BOLT-ON EXTENSION SHIPPED
- 12. OUTLET DOWNCOMER
- 13. 24"Ø MANWAY WITH BOLT-ON EXTENSION SHIPPED LOOSE 14. 4"Ø FTG.FOR OIL PUMP-OUT WITH INTERNAL PIPE INSTALLED & RISER PIPE SHIPPED LOOSE
- 15. 2"ø FTG. FOR LEVEL SENSOR WITH RISER PIPE SHIPPED LOOSE
- 16. LIFTING LUG
- 17. 2"ø FTG. FOR VENT
- 18. 4"ø FTG. FOR GAUGE WITH PLUG
- 19. 2"ø FTG. FOR LEAK DETECTION
- 20. 1/4" BULKHEAD
- 21. EFFLUENT WATER CHAMBER
- 22. INTERNAL RIBBON ANODE
- 23. PUMP MOUNT
- 24. 4" FTG. FOR PUMP CONDUIT 25. 3" FTG. FOR EFFLUENT WATER CHAMBER LEVEL SENSOR

