


TOUCH UP OF FINISHED PAINT IS
REQUIRED BY INSTALLATION
CONTRACTOR. TOUCH UP PAINT SHIPPED
WITH TANK.

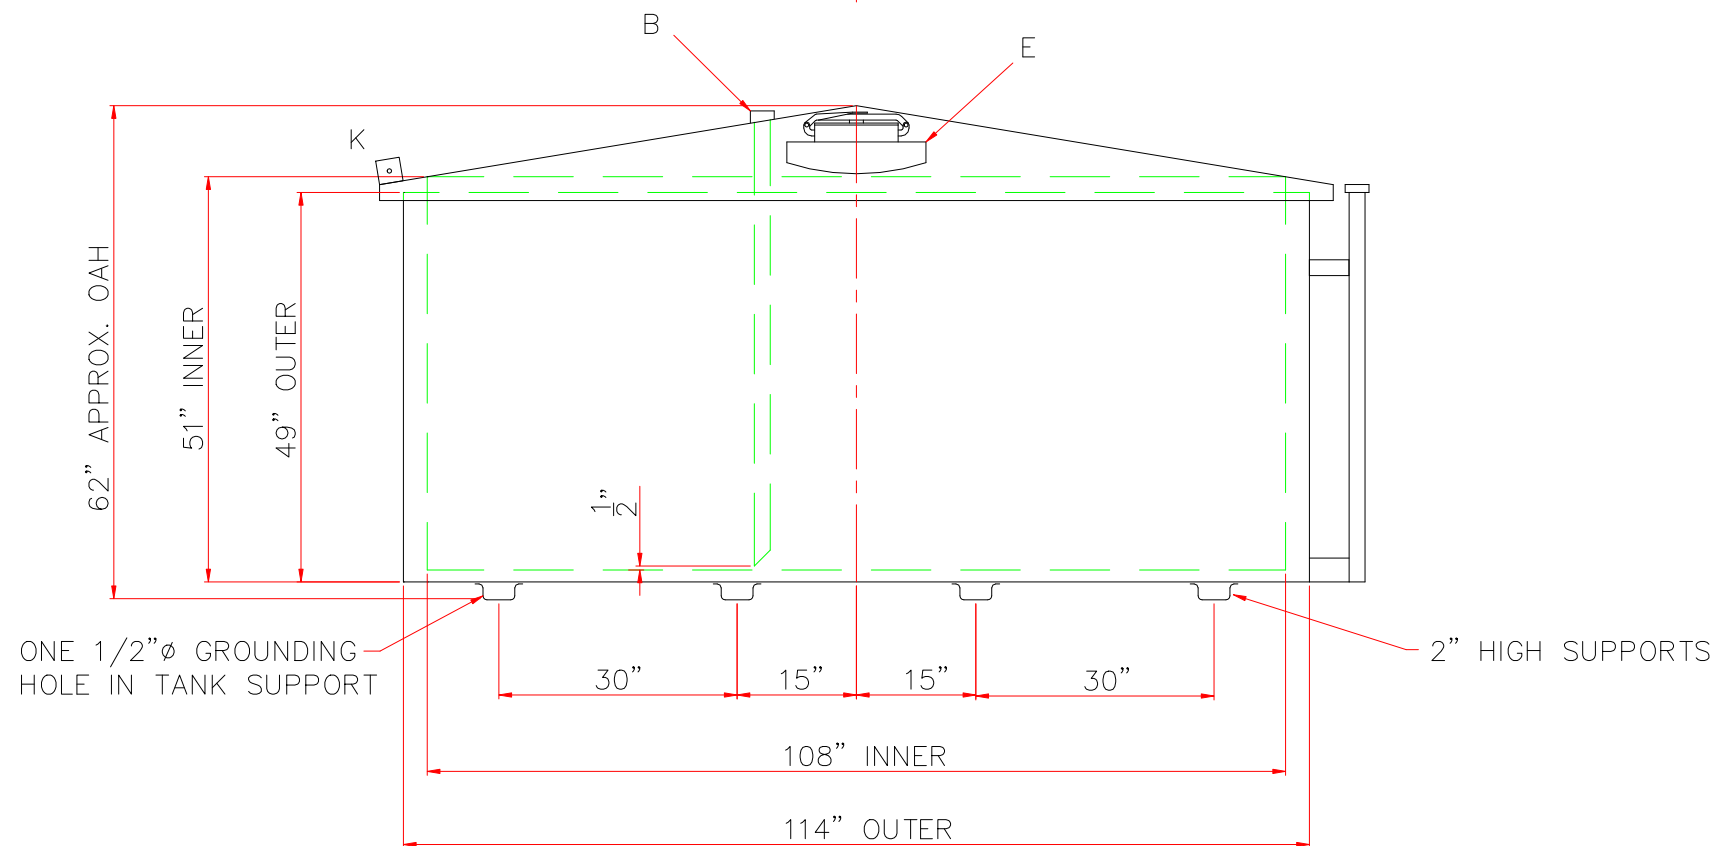

DESIGN DATA	LEGEND	
CAPACITY – 2,000 GALLONS	A	6" FFSO 150# FLANGE – PRIMARY EMERGENCY VENT USE ONLY
NO. REQ. – –	B	2" HALF COUPLING WITH QUICK CONNECT & DROP PIPE TO WITHIN 1/2" OF TANK BOTTOM.
OPERATING PRESSURE – ATMOSPHERIC	C	4" HALF COUPLING (SPARE)
SPECIFIC GRAVITY = 1.0	D	2" HALF COUPLING (NORMAL VENT)
TANK MATERIAL – MILD CARBON STEEL	E	12" x 16" MANWAY WITH BETT'S 10"Ø QUICK OPEN FILL IN COVER.
THICKNESS – TOP: 7 GA FLANGED CONE OR STD. FLANGED & DISHED	F	2" MONITOR PIPE
THICKNESS – BALANCE OF TANK – 7 GA	G	2" HALF COUPLING (SPARE)
CONSTRUCTION – TANK – LAP WELD OUTSIDE ONLY (INNER TANK IS NOT ATTACHED TO OUTER TUB)	H	2" HALF COUPLING (SPARE)
CONSTRUCTION – TUB – LAP WELD OUTSIDE ONLY	J	–
TANK TEST – TANK ONLY – 5 PSIG	K	3" x 3" PLATE w/ 1/2"Ø HOLE (MIN.) HOLE ON CENTER (GROUNDING LUG – ONE REQ'D ON THE LID), HTM SHOP TO DRILL ONE 1/2"Ø IN THE TANK SUPPORT.
TUB TEST – TUB ONLY – WATERTIGHT		
FINISH – TUB – INSIDE AND OUT – SHOP PRIMER		
FINISH – TANK – INTERIOR – NONE		
FINISH – TANK – EXTERIOR – SAME AS TUB		
LABEL – UL 142 – APPLY LABEL ON TOP OF TANK		
TANK SUPPORT – 10 GA x 4" WIDE x 2" DEEP PRESSBRAKE "U" PATTERN		

SHIP LOOSE: (INSTALLATION BY OTHERS)

- (1) 2"Ø x 96" LONG GALVANIZED PIPE (T.B.E.)
- (1) 2"Ø MUSHROOM VENT
- (1) 6" EMERGENCY VENT

 <h1>Highland Tank</h1>	
UNLESS NOTED, TOLERANCES ARE $\pm 1"$	
2,000 GAL HAZ HOPPER	
CUSTOMER:	
PROJECT:	
QUOTE NO:	CHK'D BY:
SCALE: 1/2"=1'-0"	DWG. NO: 2000HH
DATE:	DWG. BY: