


TOUCH UP OF FINISHED PAINT IS
REQUIRED BY INSTALLATION
CONTRACTOR. TOUCH UP PAINT SHIPPED
WITH TANK.

(1) 8" FLANGED EMERGENCY VENTS
(1) 6" FLANGED EMERGENCY VENTS
(1) HIGH-LINK LEVEL SHIELD MODEL# LS_XE_{XD}_1750 69"
LONG & BUSHING WITH LS_LINK_GPRS COMMUNICATION BOX.


Diagram of a cylindrical tank with the following dimensions and labels:

- Outer diameter: $\phi 5'-10"$ OUTER
- Inner diameter: $\phi 5'-4"$ INNER
- Label E points to the top center of the tank.
- Label SHIPMENT BANDING HOLES (2) PER SADDLE points to the two small circles on the tank's side.

Technical drawing of a rectangular plate. The overall width is 62". The overall height is 6". The plate has two 2" diameter holes, one on each side. The distance from the left edge to the center of the left hole is 25". The distance between the centers of the two holes is 25". The distance from the center of the right hole to the right edge is 25".

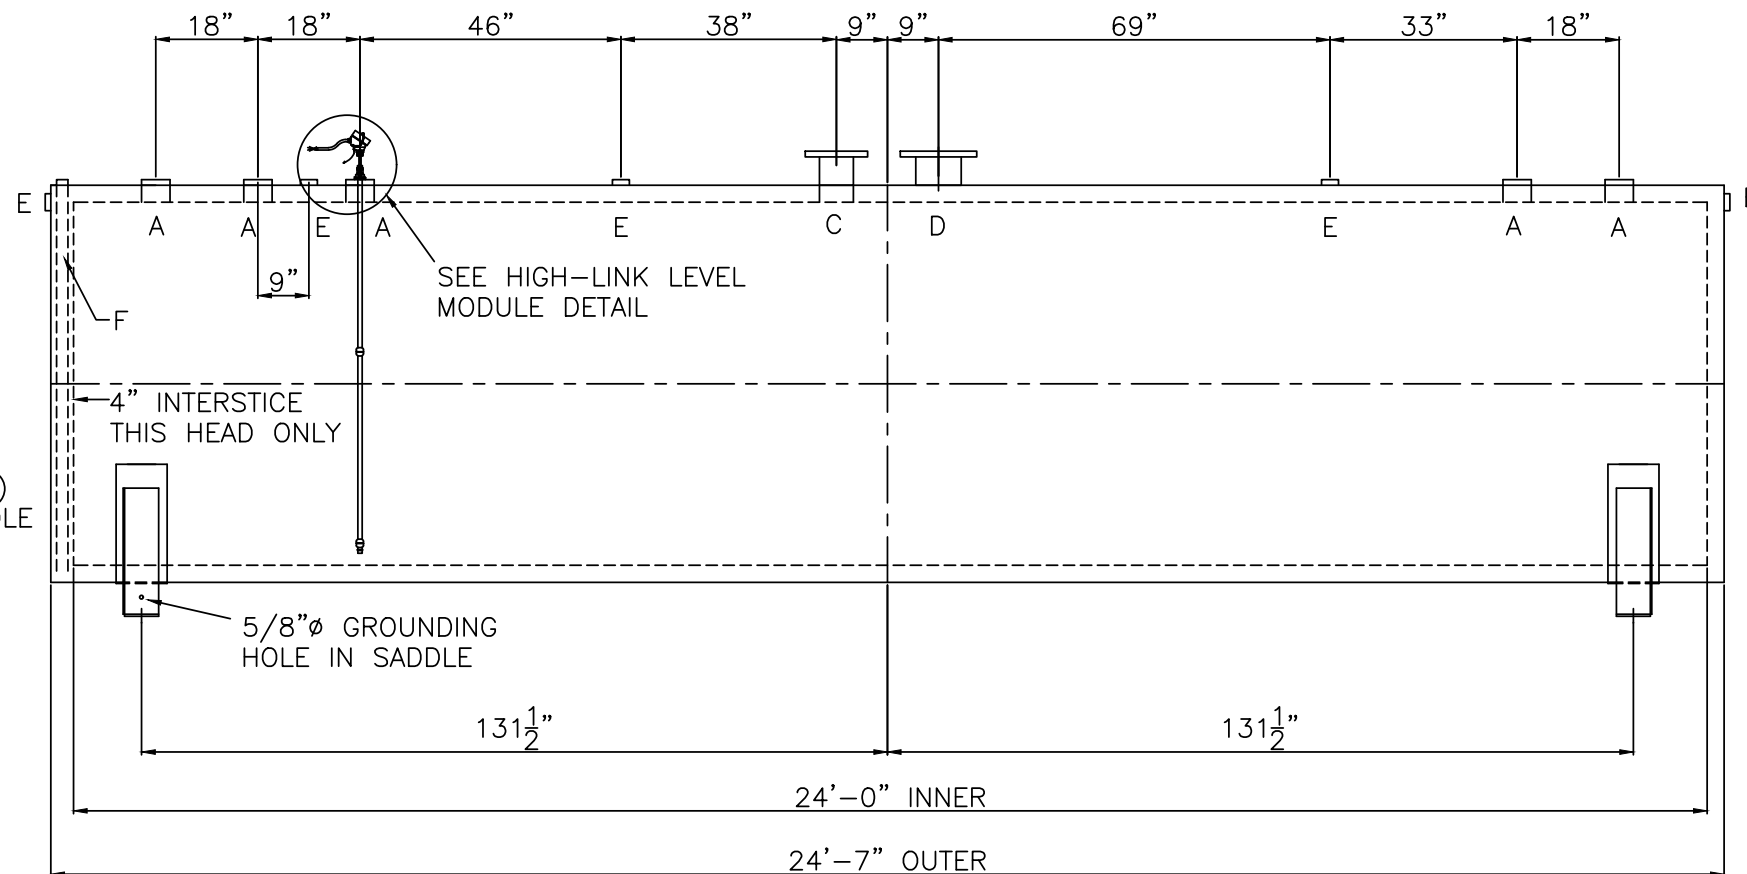

HIGH-LINK LEVEL SHIELD DETAIL



COMMUNICATION
BOX DETAIL

CAPACITY : 2,000 GALLONS
TYPE: FIREGUARD® CYLINDRICAL
FIREGUARD® IS A TRADEMARK OF THE STEEL TANK INSTITUTE
NO. REQ. – –
OPERATING PRESSURE – ATMOSPHERIC
SPECIFIC GRAVITY = 1.0
TANK MATERIAL – MILD CARBON STEEL
THICKNESS – INNER – HEADS AND SHELL – 7 GAUGE
THICKNESS – OUTER – HEADS AND SHELL – 7 GAUGE
MIN. GAUGE OR THICKNESS (PER U.L. 2085)
CONSTRUCTION – INNER – LAP WELD OUTSIDE ONLY
CONSTRUCTION – OUTER – LAP WELD OUTSIDE ONLY
TANK TEST – INNER – 5 PSIG
OUTER – 5 PSIG
INT. FINISH – NONE
EXT. FINISH – SP-6 BLAST, FINISH PAINT WHITE
LABEL– UL 2085 AND FIREGUARD® PER sti

A	4" FEMALE FIREGUARD COUPLING
B	—
C	6" FFSO 150# FLANGE — PRIMARY EMERGENCY VENT USE ONLY
D	8" FFSO 150# FLANGE THROUGH OUTER SHELL ONLY, MARK WITH SPECIAL WARNING LABEL INTERSTITIAL EMERGENCY VENT USE ONLY
E	2" FITTING THROUGH OUTER SHELL ONLY WITH CAST IRON PLUG— MFG USE ONLY
F	2" INTERSTITIAL MONITOR PIPE — MALE NPT END

NOTES:
STRIKER PLATES ARE NOT SUPPLIED ON
FIREGUARDS® UNLESS SPECIFIED

