NOTE: ALL RIGHTS RESERVED. THIS DRAWING MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK®. HIGHLAND TANKO SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE AND COATINGS SHOWN ON THIS DRAWING.

11

Ø8'-6"

OUTER

Ø8'-0

102" x 6" HIGH

SEAL WELD TO TANK

91"

SADDLES STI SPECIFICATION,

**INNER** 

TOUCH UP OF FINISHED PAINT IS REQUIRED BY INSTALLATION CONTRACTOR. TOUCH UP PAINT SHIPPED WITH TANK.

SHIPPING LUGS AS NEEDED

SADDLE


2"ø HOLES TYP

SHIP LOOSE

(2) 8" FLANGED EMERGENCY VENTS

INSTALLED

(1) HIGH-LINK LEVEL MODULE MODEL# LS\_XEXD 108" LONG & BUSHING.

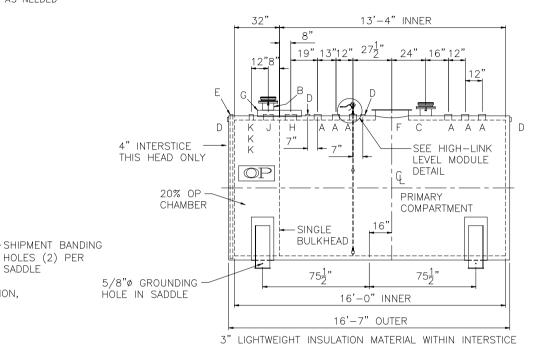



STRIKER PLATES ARE NOT SUPPLIED ON FIREGUARDS® UNLESS SPECIFIED

DESIGN DATA CAPACITY: 5,000 GALLONS TYPE: FIREGUARD® CYLINDRICAL FIREGUARD® IS A TRADEMARK OF THE STEEL TANK INSTITUTE NO. REQ. - -OPERATING PRESSURE - ATMOSPHERIC SPECIFIC GRAVITY = 1.0 TANK MATERIAL — MILD CARBON STEEL THICKNESS - INNER - HEADS-5/16" SHELL-1/4" THICKNESS - OUTER - HEADS- 5/16" SHELL-1/4 MIN. GAUGE OR THICKNESS (PER Ú.L. 2085) CONSTRUCTION - INNER - LAP WELD OUTSIDE ONLY CONSTRUCTION — OUTER — LAP WELD OUTSIDE ONL' TANK TEST - PER UL 2085 INT. FINISH - NONE EXT. FINISH - SP-6 BLAST, FINISH PAINT WHITE LABEL- UL 2085 AND FIREGUARD® PER sti

$\dashv$	<u>LEGEND</u>			
	Α	4" FEMALE FG COUPLING	G	31" LONG x 14" WIDE x 4" HIGH CLOSED TOP STEEL ENCLOSURE WELDED TO OUTER TANK
" '4" _Y LY	В	8" FFSO 150# FLANGE — PRIMARY EMERGENCY VENT USE ONLY	Н	8" SCH 40 PIPE
	С	8" FFSO 150# FLANGE THROUGH OUTER SHELL ONLY, MARK WITH SPECIAL WARNING LABEL	J	6" FEMALE FIREGUARD COUPLING
		INTERSTITIAL EMERGENCY VENT USE ONLY	K	2" FEMALE FIREGUARD COUPLING
	D	2" FITTING THROUGH OUTER SHELL ONLY WITH CAST IRON PLUG- MFG USE ONLY	L	_
	Ε	2" MONITOR PIPE WITH MALE NPT END		
	F	24" x 1/4" PLATE TIGHT BOLT MANWAY WITH 1/8" THICK NEO-CORK GASKET		

