
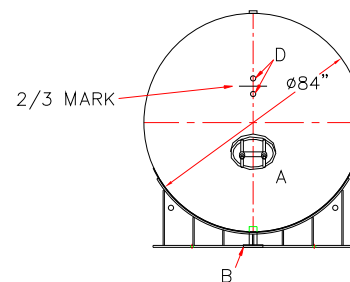
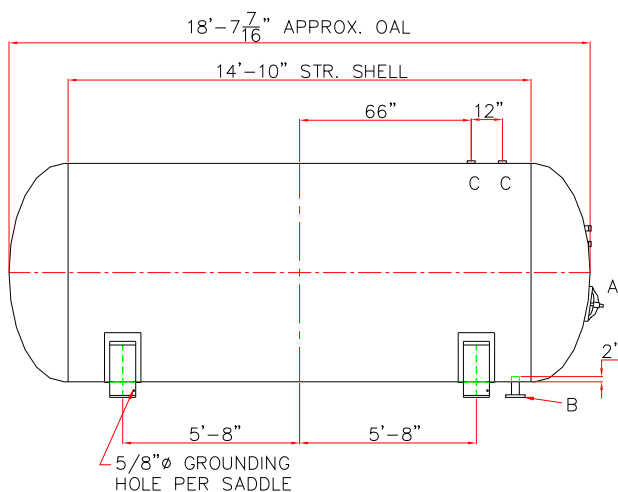


TOUCH UP OF FINISHED PAINT IS
REQUIRED BY INSTALLATION
CONTRACTOR. TOUCH UP PAINT SHIPPED
WITH TANK.

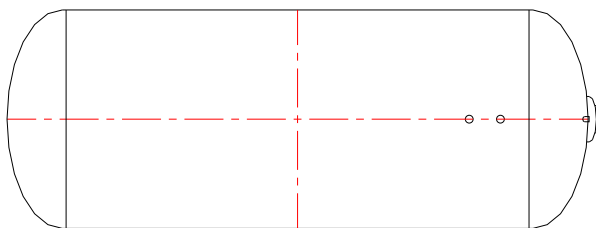

CAPACITY - 5,000 GALLONS			
TYPE - ABOVEGROUND FIRE PROTECTION VESSEL			
NO. REQ. - ____			
MAX. ALLOW. WORKING PRES. -	____	PSIG @	140 °F
MAX ALLOW. EXTERNAL W.P. -	____	PSIG @	140 °F
MIN. DESIGN METAL TEMP -	-20°F	@ ____	PSIG
HYDROSTATIC TEST PRESSURE -	____	PSIG	

CORROSION ALLOWANCE- ____
POSTWELD HEAT TREATED - ____

RADIOGRAPHY - ___

HEADS - ___ SA516 GR 70 ASME 2:1 ELLIPTICAL
SHELL - ___ SA516 GR 70

INT. FINISH - SSPC, SP10 BLAST
HIGH™DRO LINER PLUS FOR NFPA 22

EXT. FINISH - GRAY SHOP PRIMER
OR
OTHER TO BE SPECIFIED

CONSTRUCTION – BUTT WELD INSIDE AND OUTSIDE

ALL TANK FABRICATIONS TO BE IN ACCORDANCE
WITH ASME SECTION VIII, DIVISION 1, LATEST EDITION,
LATEST ADDENDA

ALL SHELL, HEAD, FITTINGS, AND MANWAYS TO BE
WELDED TO BIGBEE STEEL WELD PROCEDURE PER
DRAWING F11151

HIGHLAND TANK SERIAL # - -

MARK	SIZE	TYPE	RATING	NOZZLE	FLANGE	COMMENTS
A	12" X 16"	ELLIPT.	300#	SA106 GR C	---	w/ NEOPRENE RUBBER GASKET
B	---	RFSO	150#	SA106 GR B	SA105	WITH 2" PROJECTION INSIDE THE TANK
C	---	HALF CPLG	3000#	SA105	---	---
D	---	HALF CPLG	3000#	SA105	---	---

