


TOUCH UP OF FINISHED PAINT IS
REQUIRED BY INSTALLATION
CONTRACTOR. TOUCH UP PAINT SHIPPED
WITH TANK.

ø6'-0" INNER

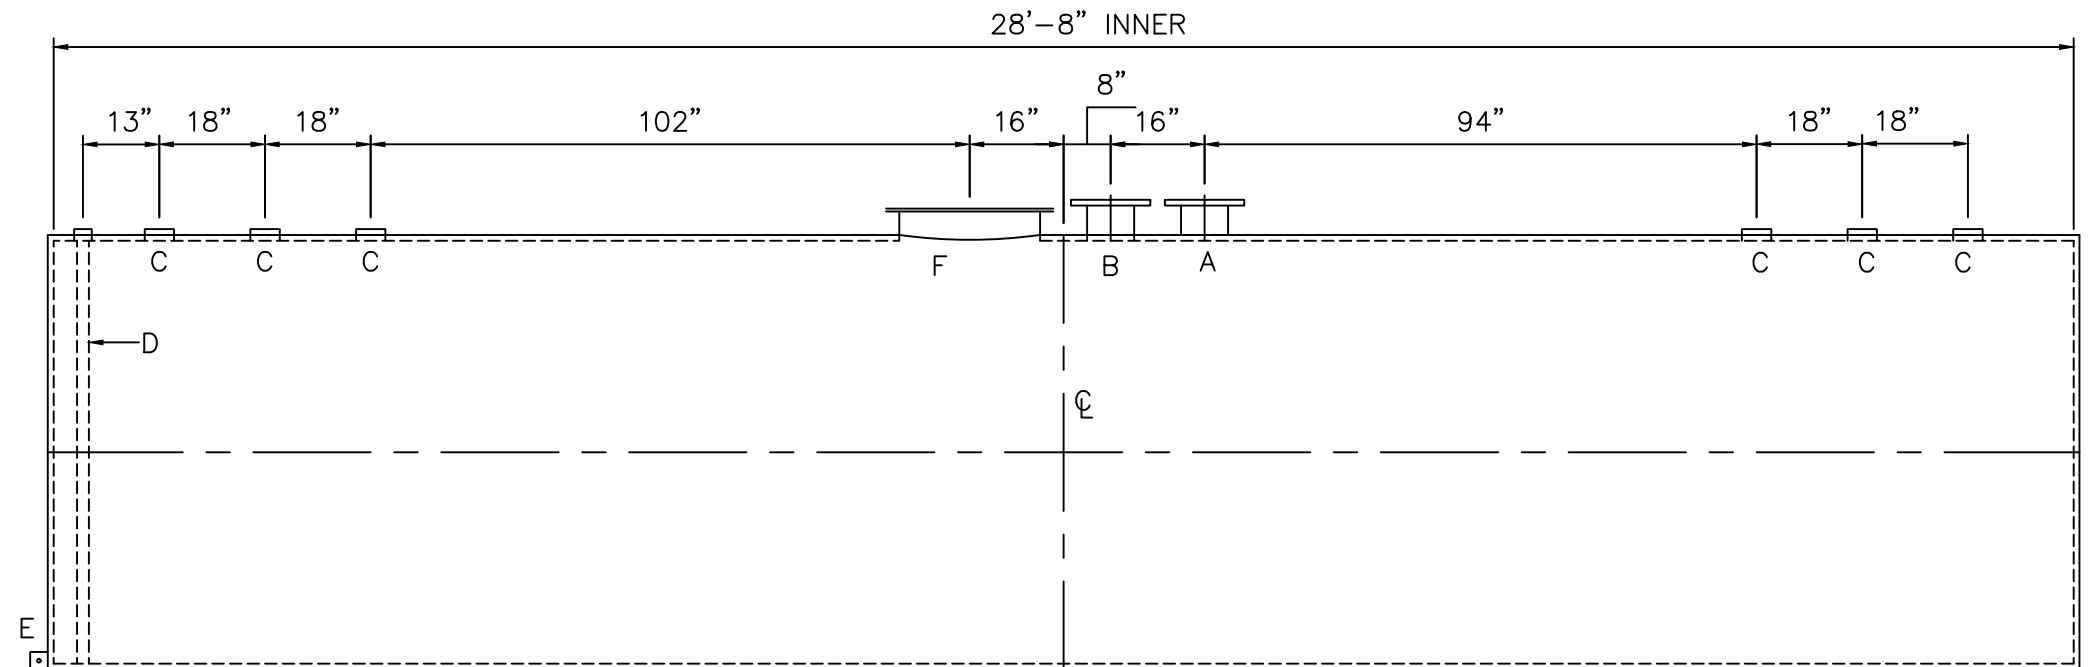

<u>DESIGN DATA</u>	
CAPACITY – 6,000 GALLONS	
TYPE – DOUBLE WALL – TYPE I	
NO. REQ. – –	
OPERATING PRESSURE – ATMOSPHERIC	
SPECIFIC GRAVITY = 1.0	
TANK MATERIAL – MILD CARBON STEEL	
THICKNESS – INNER– HEADS: 1/4"	SHELL: 1/4"
THICKNESS – OUTER– HEADS: 10 GA	SHELL: 10 GA
CONSTRUCTION – INNER – LAP WELD OUTSIDE ONLY OUTER – LAP WELD OUTSIDE ONLY	
TANK TEST – INNER – 5 PSIG OUTER – +3 PSIG OR 13"hg VACUUM	
INT. FINISH – NONE –	
EXT. FINISH – SHOP PRIMER –	
LABEL – UL 142	

<u>LEGEND</u>	
A	8" FFSO 150# FLANGE THROUGH OUTER SHELL ONLY, MARK WITH SPECIAL WARNING LABEL – INTERSTITIAL EMERGENCY VENT USE ONLY
B	8" FFSO 150# FLANGE – PRIMARY EMERGENCY VENT
C	4" FITTING
D	2" INTERNAL INTERSTITIAL MONITOR PIPE
E	3" x 3" PLATE W/ 1/2"ø (MIN.) HOLE ON Ⓠ (GROUNDING LUG – ONE REQ'D)
F	24"ø TIGHT BOLT MANWAY w/ 1/8" FIBREFLEX GASKET MATERIAL.

