

NOTE: ALL RIGHTS RESERVED. THIS DRAWING MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK®. HIGHLAND TANK®. HIGHLAND TANK® SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTIVES OF SIZE AND LOCATION OF FITTINGS, ACCESORIES, AND COATINGS SHOWN ON THIS DRAWING.



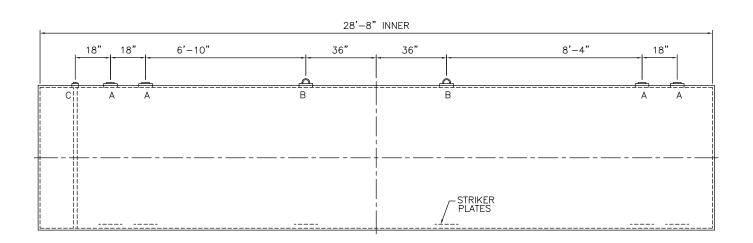

STRIKER PLATES ROLLED & SEAL WELDED TO THE TANK, 1/4" X 12" x 12" MIN.

DESIGN DATA

CAPACITY - 6,000 GALLON

| TYPE - DOUBLE WALL - 360° TYPE II                                    |   |                                 |
|--|---|---------------------------------|
| NO. REQ. — —   |   |                                 |
| OPERATING PRESSURE - ATMOSPHERIC                                     |   |                                 |
| TANK MATERIAL — MILD CARBON STEEL                                    |   |                                 |
| THICKNESS - HEADS- 7 GAUGE   |   | <u>LE</u>                       |
| THICKNESS — SHELL — .187"<br>*GA THK. BASED ON 60" MAX. BURIAL DEPTH | A | 4" CLOSE OFF F                  |
| CONSTRUCTION — LAP WELD OUTSIDE ONLY<br>—                            | В | 4" CLOSE OFF F                  |
| TANK TEST — INNER: 5 PSIG<br>OUTER: FULL VACUUM                      | С | 2" CLOSE OFF FI<br>MONITOR PIPE |
| INT. FINISH — NONE<br>—  | D | _                               |
| EXT. FINISH — GREEN TITAN® WRAP                                      | E | _                               |
| LABEL - UL-58/UL-1746 PART III                                       | F | _                               |
|  |   |                                 |

|   | <u>LEGEND</u>  |  |  |  |
|---|--|--|--|--|
| Α | 4" CLOSE OFF FITTING                                       |  |  |  |
| В | 4" CLOSE OFF FITTING WITH REMOVABLE LIFT LUG               |  |  |  |
| С | 2" CLOSE OFF FITTING WITH INTERNAL INTERSTICE MONITOR PIPE |  |  |  |
| D | _  |  |  |  |
| E | -  |  |  |  |
| F | -  |  |  |  |

