
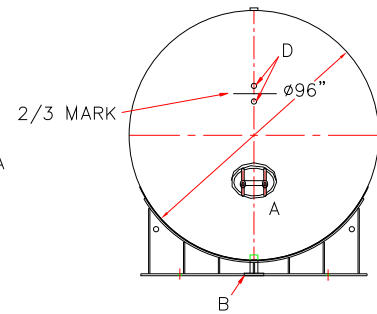
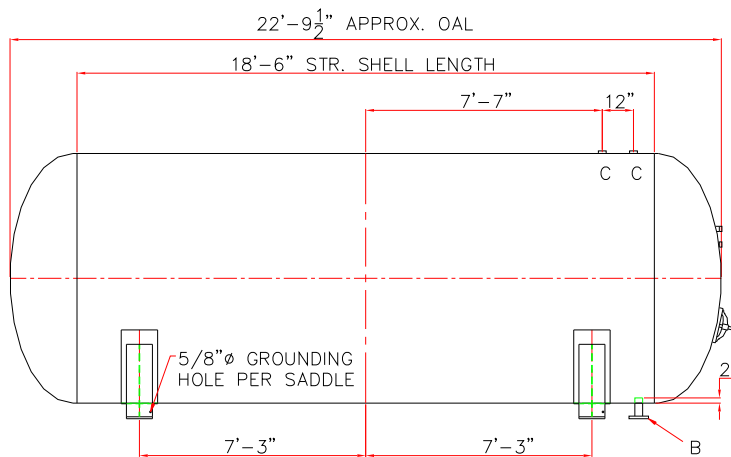


NOTE: ALL RIGHTS RESERVED. THIS DRAWING MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK®. HIGHLAND TANK® SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE AND LOCATION OF FITTINGS, ACCESSORIES, AND COATINGS SHOWN ON THIS DRAWING.

TOUCH UP OF FINISHED PAINT IS REQUIRED BY INSTALLATION CONTRACTOR. TOUCH UP PAINT SHIPPED WITH TANK.

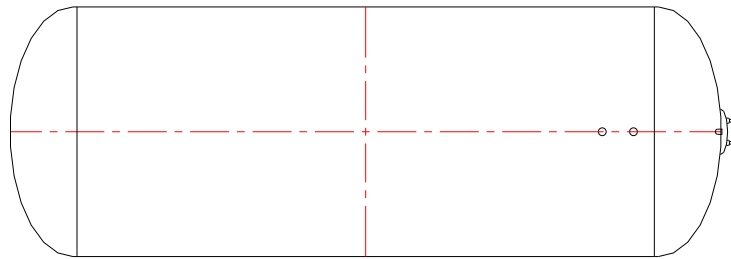

DESIGN DATA
CAPACITY – 8,000 GALLONS
TYPE – ABOVEGROUND FIRE PROTECTION VESSEL
NO. REQ. – ---
MAX. ALLOW. WORKING PRES.– ___PSIG @ 140 °F
MAX ALLOW. EXTERNAL W.P. – ___PSIG @ 140 °F
MIN. DESIGN METAL TEMP – –20°F @ ___PSIG
HYDROSTATIC TEST PRESSURE – ___ PSIG
CORROSION ALLOWANCE– ---
POSTWELD HEAT TREATED – ---
RADIOGRAPHY – ---
HEADS – --- SA516 GR 70 ASME 2:1 ELLIPTICAL
SHELL – --- SA516 GR 70
INT. FINISH – SSPC, SP10 BLAST HIGH™DRO LINER PLUS FOR NFPA 22
EXT. FINISH – GRAY SHOP PRIMER OR OTHER TO BE SPECIFIED
CONSTRUCTION – BUTT WELD INSIDE AND OUTSIDE
ALL TANK FABRICATIONS TO BE IN ACCORDANCE WITH ASME SECTION VIII, DIVISION 1, LATEST EDITION, LATEST ADDENDA
ALL SHELL, HEAD, FITTINGS, AND MANWAYS TO BE WELDED TO BIGBEE STEEL WELD PROCEDURE PER DRAWING F11151
HIGHLAND TANK SERIAL # – –

LEGEND						
MARK	SIZE	TYPE	RATING	NOZZLE	FLANGE	COMMENTS
A	12" X 16"	ELLIPT.	300#	SA106 GR C	---	w/ NEOPRENE RUBBER GASKET
B	---	RFSO	150#	SA106 GR B	SA105	WITH 2" PROJECTION INSIDE THE TANK
C	---	HALF CPLG	3000#	SA105	---	---
D	---	HALF CPLG	3000#	SA105	---	---



Highland Tank®

8000 GALLON 96"Ø ABOVEGROUND
HORIZONTAL FIRE PROTECTION VESSEL

CUSTOMER: _____

PROJECT: _____

QUOTE NO: _____

SCALE: 1/4" = 12" DATE: _____ DWG. BY: _____ DWG. NO: 08000FPPV96

CHK'D BY: _____