


TOUCH UP OF FINISHED PAINT IS
REQUIRED BY INSTALLATION
CONTRACTOR. TOUCH UP PAINT SHIPPED
WITH TANK.

A diagram of a circular structure, likely a well or a large pipe. The structure is represented by a circle with a dashed line indicating the inner diameter. A horizontal line passes through the center of the circle, and a vertical dashed line also passes through the center. A diagonal line is drawn from the center to the right edge of the circle. The text "ø8'-0\"/>

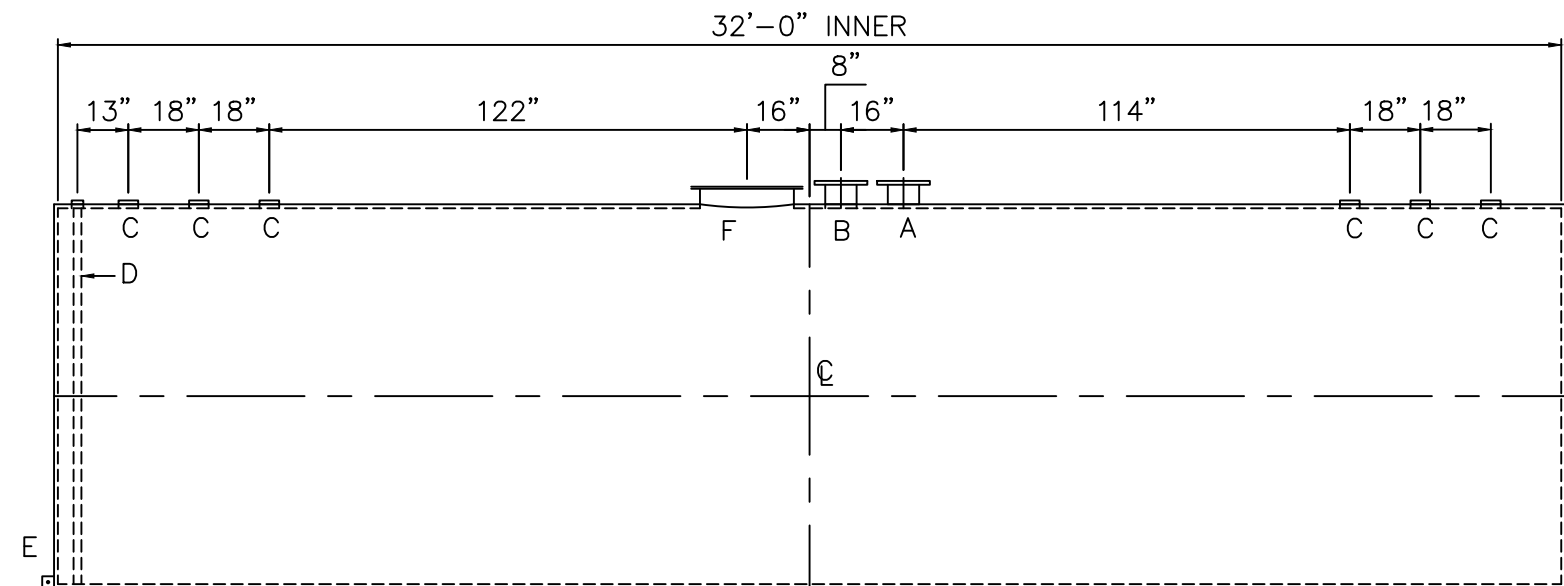

CAPACITY – 12,000 GALLONS
TYPE – DOUBLE WALL – TYPE I
NO. REQ. – –
OPERATING PRESSURE – ATMOSPHERIC
SPECIFIC GRAVITY = 1.0
TANK MATERIAL – MILD CARBON STEEL
THICKNESS – INNER– HEADS: 5/16” SHELL: 1/4”
THICKNESS – OUTER– HEADS: 7 GA SHELL: 7 GA
CONSTRUCTION – INNER – LAP WELD OUTSIDE ONLY OUTER – LAP WELD OUTSIDE ONLY
TANK TEST – INNER – 5 PSIG OUTER – +3 PSIG OR 13”hg VACUUM
INT. FINISH – NONE –
EXT. FINISH – SHOP PRIMER –
LABEL – UL 142

A	8" FFSO 150# FLANGE THROUGH OUTER SHELL ONLY, MARK WITH SPECIAL WARNING LABEL – INTERSTITIAL EMERGENCY VENT USE ONLY
B	8" FFSO 150# FLANGE – PRIMARY EMERGENCY VENT
C	4" FITTING
D	2" INTERNAL INTERSTITIAL MONITOR PIPE
E	3" x 3" PLATE W/ 1/2"Ø (MIN.) HOLE ON ⌀ (GROUNDING LUG – ONE REQ'D)
F	24"Ø TIGHT BOLT MANWAY w/ 1/8" FIBREFLEX GASKET MATERIAL.

