


NOTE :  
ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK.  
HIGHLAND TANK SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE / LOCATION OF FITTINGS , ACCESSORIES & COATINGS SHOWN ON THIS DRAWING

NOTE:  
SEE PLAN VIEW FOR TRUE ORIENTATION & LOCATION OF FITTINGS


NOTE:  
LIFTING LUGS FOR UNLOADING UNIT & STANDING UNIT UPRIGHT TO BE PLACED AS NEEDED BY FABRICATION SHOP

FITTING SCHEDULE

A= 4" ∅ NPT  
B= 18" ∅ LOOSEBOLT MANHOLE (EMERGENCY VENT)

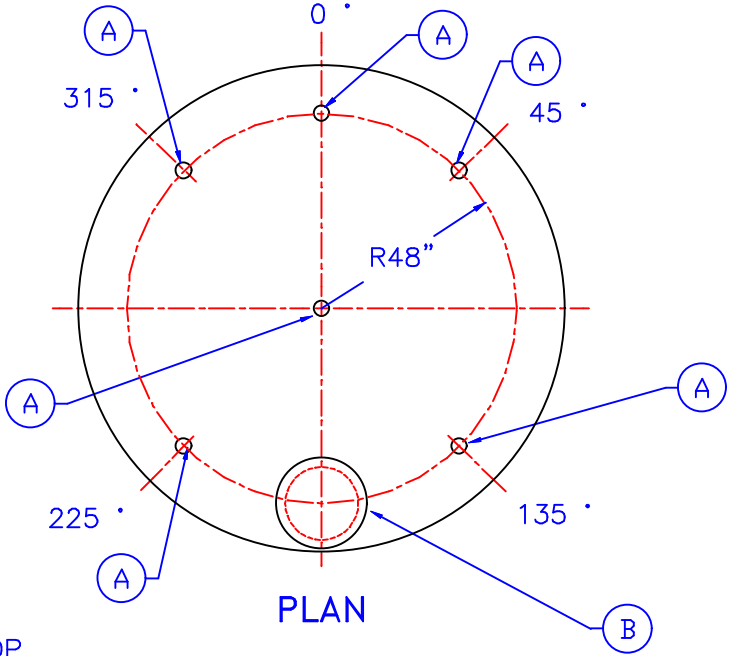

8" HIGH CONED TOP

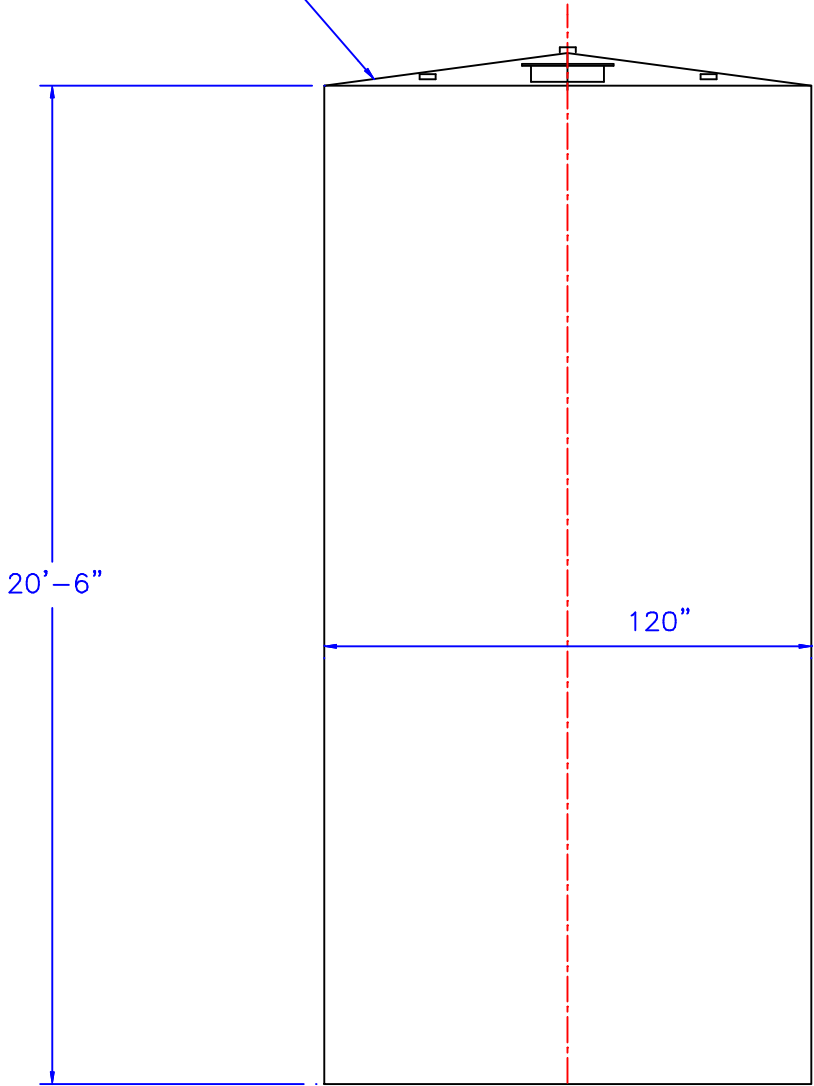

GENERAL NOTES

CAPACITY : 12000 GALLONS  
TYPE : SINGLE WALL, ABOVEGROUND VERTICAL  
NO. REQ. :  
MATERIAL : MILD CARBON STEEL  
TEST : 1.5 TO 2.5 P.S.I.  
MIN. GAUGE OR THICKNESS (PER U.L. 142):  
    BOTTOM HEAD : 1/4"  
    SHELL : 1/4"  
    CONED TOP HEAD : 7 GA.  
  
PAINT :  
    INTERIOR : NONE  
    EXTERIOR : RED PRIMER  
CONSTRUCTION : FLAT BOTTOM HEAD, CONED TOP HEAD.  
    LAP WELD ALL EXTERIOR SEAMS EXCEPT  
    BUTT WELD ALL LONGITUDINAL SEAMS  
APPROVED LABELS : U.L. 142

| REVISIONS                                                                             |                  |                      |                        |
|---------------------------------------------------------------------------------------|------------------|----------------------|------------------------|
|  |                  | <b>Highland Tank</b> |                        |
| 12000 GALLON ABOVEGROUND VERTICAL<br>SINGLE WALL                                      |                  |                      |                        |
| CUSTOMER:                                                                             |                  |                      |                        |
| PROJECT:                                                                              |                  |                      |                        |
| QUOTE NO:                                                                             |                  | CHK'D BY:            |                        |
| SCALE:<br>1/4"=1'-0"                                                                  | DATE:<br>5-19-99 | DWG. BY:             | DWG. NO.:<br>12K AV SW |