


NOTE:
HIGHLAND TANK & MFG. CO. SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING. CONTRACTOR OR OTHERS SHALL BE RESPONSIBLE FOR ANY ITEMS NOT INDICATED ON DRAWING INCLUDING, BUT NOT LIMITED TO, INTERNAL / EXTERNAL PIPING—COATINGS—FITTINGS—ACCESSORIES, ETC. APPROVER OF DRAWING SHALL BE RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE / LOCATION OF FITTINGS, ACCESSORIES, COATINGS, ETC. HIGHLAND TANK & MFG. CO. SHALL FABRICATE TANK IN ACCORDANCE TO THIS DRAWING (WHICH MAY OR MAY NOT BE IN EXACT ACCORDANCE TO PLANS & SPECIFICATIONS)

FITTING SCHEDULE

- A= 4" ø NPT
B= 18" ø LOOSE BOLT MANHOLE FOR PRIMARY EMERGENCY VENT
C= 2" ø NPT (FITTING FOR LEAK DETECTION)
D= 18" ø LOOSE BOLT MANHOLE FOR SECONDARY EMERGENCY VENT (NOT TO PENETRATE INNER TANK)

GENERAL NOTES

CAPACITY : 25000 GALLONS
TYPE : I 360 DOUBLE WALL, ABOVEGROUND HORIZONTAL
NO. REQ. :
MATERIAL : MILD CARBON STEEL
TEST : 5 P.S.I.
MIN. GAUGE OR THICKNESS (PER U.L. 142):
INNER HEADS : 5/16" OUTER HEADS : 7 GA.
INNER SHELL : 1/4" OUTER SHELL : 7 GA.
PAINT :
 INTERIOR : NONE
 EXTERIOR : RED PRIMER
CONSTRUCTION : FLAT FLANGED HEADS, LAP WELD ALL EXTERIOR SEAMS ONLY
APPROVED LABELS : U.L. 142

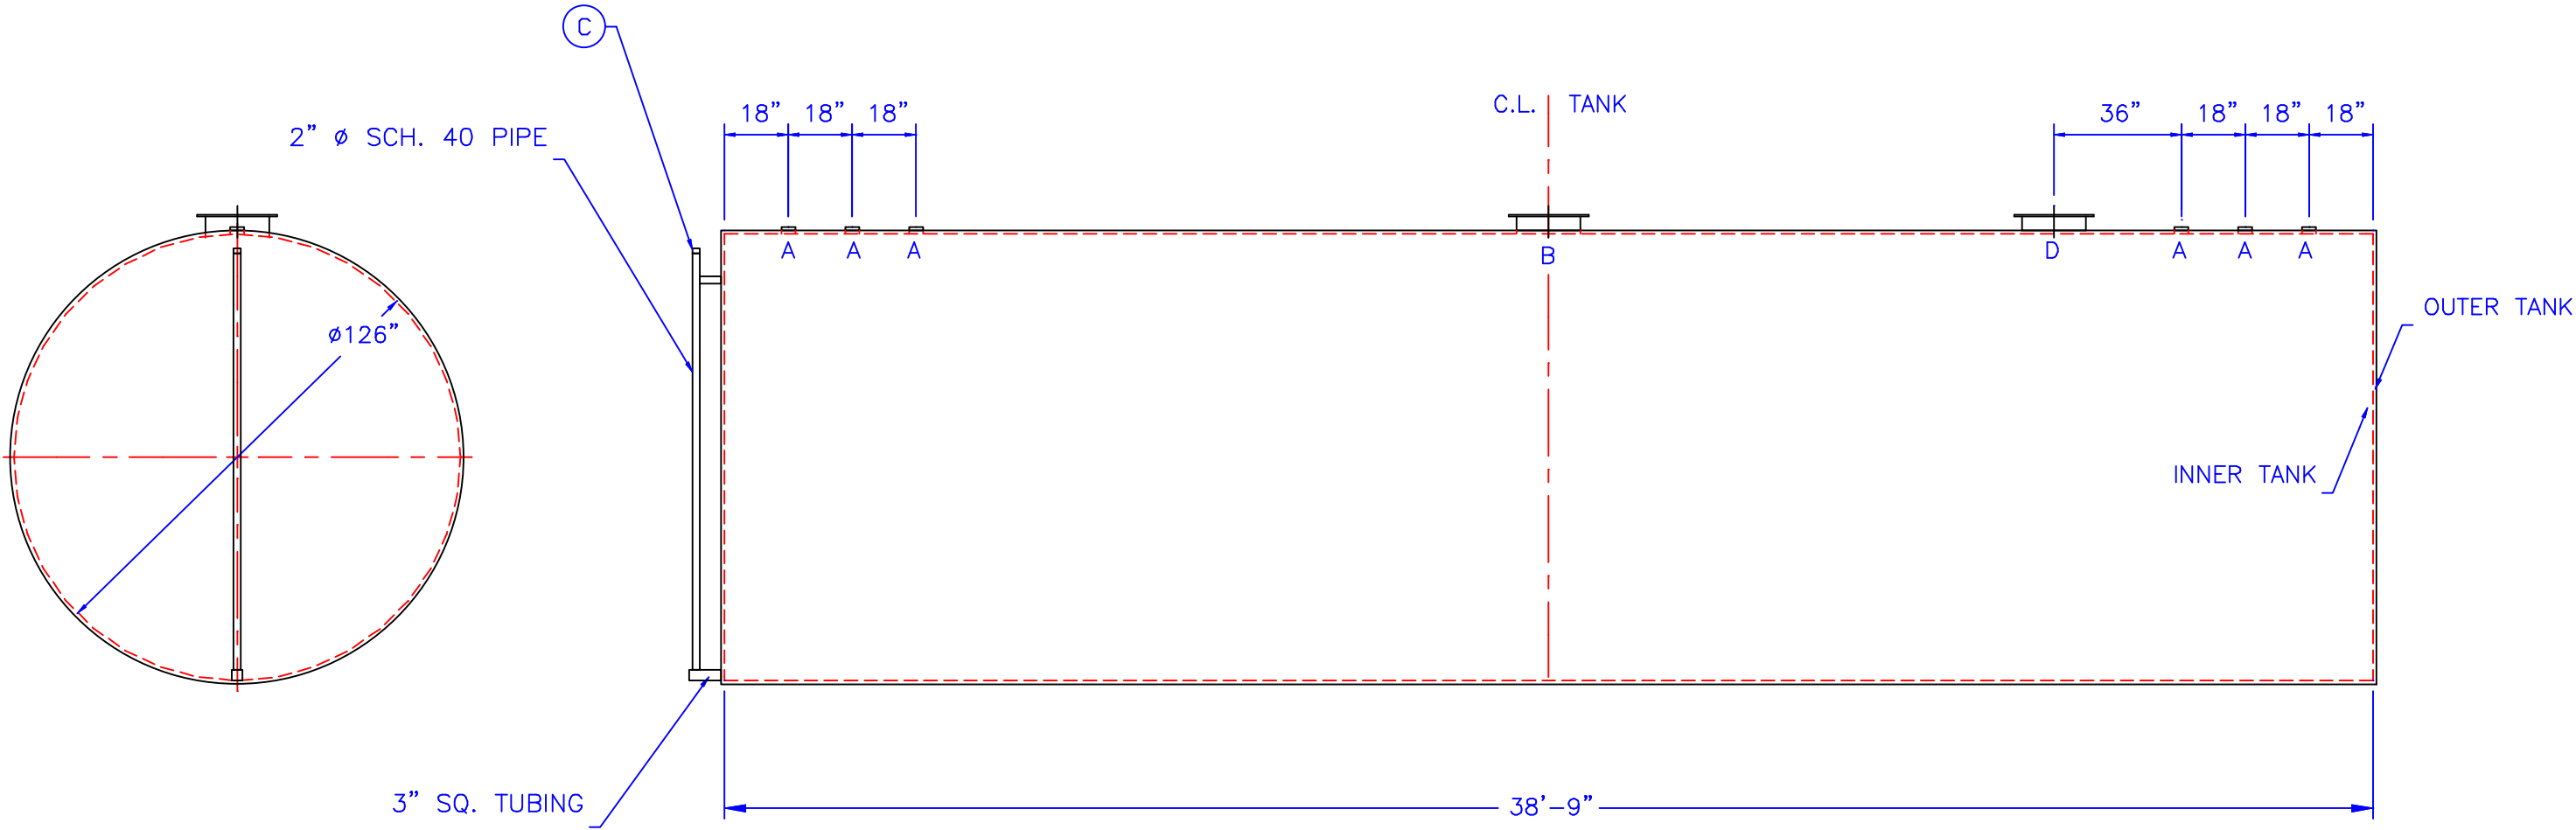

END VIEW

ELEVATION

REVISIONS			
		Highland Tank	
CUSTOMER:			
PROJECT:			
QUOTE NO:		CHK'D BY:	
SCALE: 1/4"=1'-0"	DATE:	DWG. BY:	DWG. NO.: