


SHIPPING LUGS AS NEEDED

1-1/8" ϕ HOLES (4 REQ'D)
 4'-4 1/2" 4'-4 1/2"
 12" 3" 3"
 11'-3"

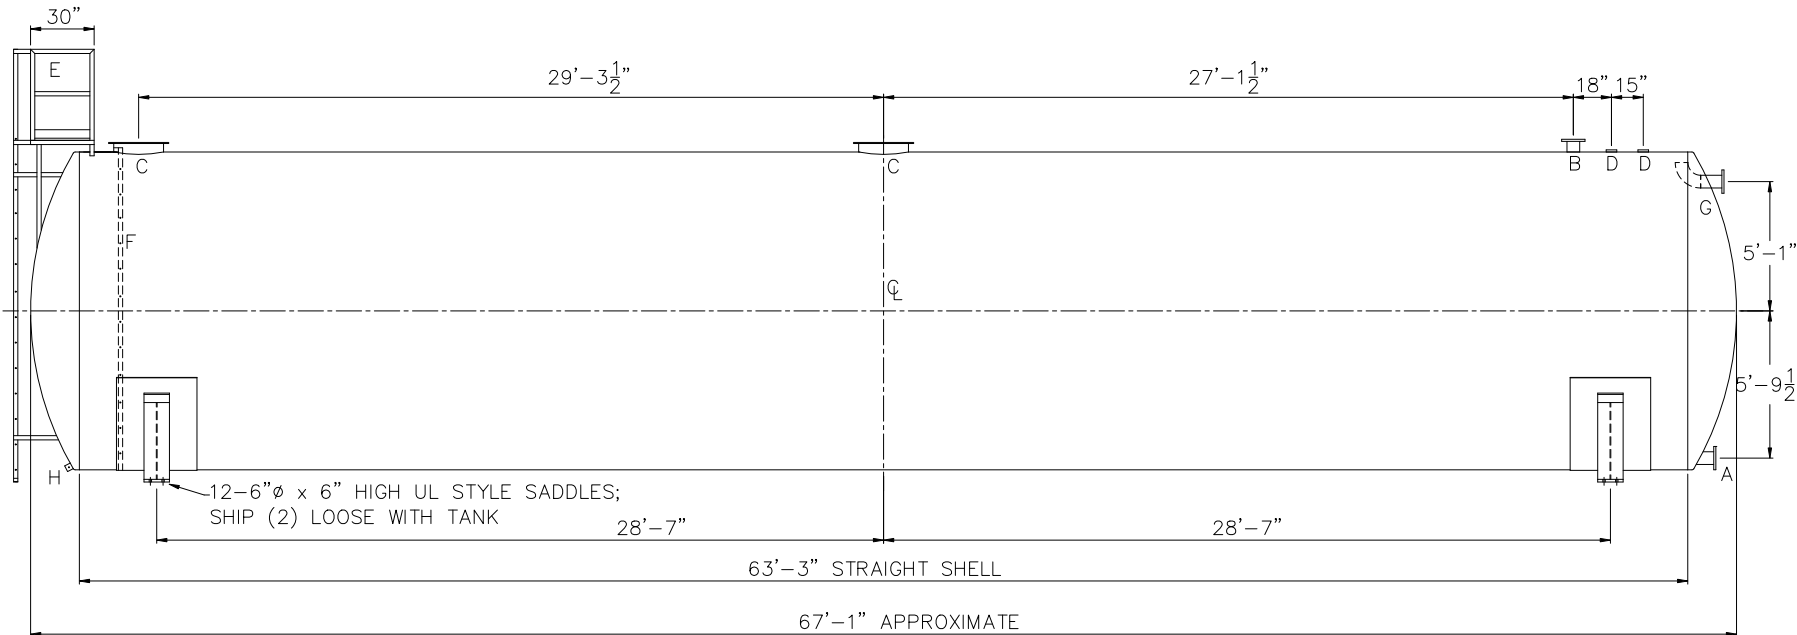

DESIGN DATA	LEGEND	
CAPACITY –60,000 GALLONS	A	FLANGE – SUPPLY
TYPE – POTABLE WATER TANK (PWT)	B	FLANGE – VENT
NO. REQ. –	C	24" X 1/4" PLATE TIGHT BOLT MANWAY WITH 1/8" THICK NEO-CORK GASKET
OPERATING PRESSURE –ATMOSPHERIC	D	4" FNPT CONNECTION
TANK MATERIAL – MILD CARBON STEEL	E	STD HTM EXTERNAL LADDER & PLATFORM ASSEMBLY – PAINTED SAFETY YELLOW AND SHIPPED LOOSE FOR INSTALLATION ON SITE BY OTHERS
THICKNESS: HEADS – 3/8" FLANGED & DISHD	F	HTM STD INTERNAL LADDER
THICKNESS: SHELL – 3/8"	G	FLANGE WITH INTERNAL 90° ELBOW SHOWN – OVERFLOW
CONSTRUCTION –LAP WELD INSIDE & OUTSIDE	H	FB-3"x 1/4"x3" WITH 5/8"Ø HOLE ON CL (GROUNDING LUG)
TANK TEST –5 PSIG		
INT. FINISH – SP10 BLAST HighDRO®-LINER PLUS FOR NSF 61 APPLICATIONS		
EXT. FINISH –SSPC SP6 BLAST, WHITE URETHANE PAINT		
LABEL – NONE		

		<h1>Highland Tank</h1>	
UNLESS NOTED, TOLERANCES ARE $\pm 1"$			
<h2>HighDRO® WATER STORAGE TANK</h2>			
60,000 GAL 150"Ø SINGLE-WALL ABOVEGROUND HORIZONTAL FOR POTABLE WATER WITH BOTTOM DRAIN			
CUSTOMER:			
PROJECT:			
QUOTE NO:		CHK'D BY:	
SCALE: $3/16" = 1'-0"$	DATE: XX/XX/XX	DWG. BY: XXXX	DWG. NO: 60000AHSWHPWTBD150