


TOUCH UP OF FINISHED PAINT IS
REQUIRED BY INSTALLATION
CONTRACTOR. TOUCH UP PAINT SHIPPED
WITH TANK.

1. SEE PLAN VIEW FOR TRUE ORIENTATION AND LOCATION OF FITTING
2. LIFTING LUGS FOR UNLOADING UNIT & STANDING UNIT UPRIGHT TO BE PLACED AS NEEDED BY FABRICATION SHOP
3. A 3x3x $\frac{1}{4}$ " STEEL GROUNDING LUG WITH A $\frac{5}{8}$ " ϕ HOLE IN CENTER TO BE PLACED ON SHELL AT BOTTOM OF TANK IN LINE WITH LIFTING LUGS

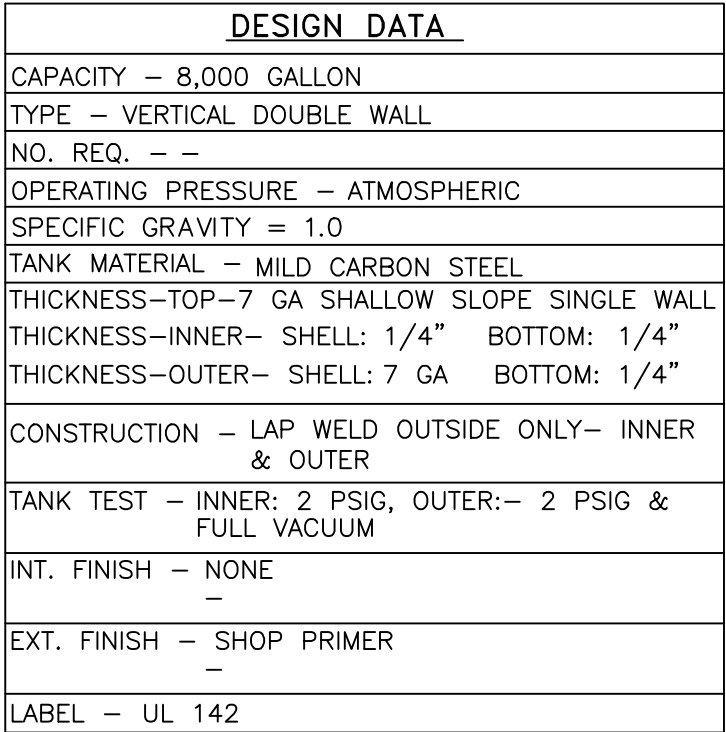

A	24" LOOSE BOLT MANWAY
B	8" FFSO 150# FLANGE IN INTERSTICE EXTENSION BOX – MARK WITH WARNING LABEL – SECONDARY EMERGENCY VENT USE ONLY
C	4" FNPT FITTING
D	2" INTERSTITIAL MONITOR PIPE
E	–
F	

BOTTOM JOINT DETAIL

 Highland Tank	
UNLESS NOTED, TOLERANCES ARE +/- 1"	
8,000 GAL 120"Ø DW VERTICAL	
CUSTOMER:	
PROJECT:	
QUOTE NO:	CHK'D BY:
SCALE: 1/4"=1'-0"	DATE:
DWG. BY:	DWG. NO: 8000AVDW120